






THOMPSON VENTURETTI STAINBACK & ASSOCIATES, INC ARCHITECTS  
 VIETTA GROUP ASSOCIATED ARCHITECTS  
 KELLY/MAIELLO ARCHITECTS & PLANNERS, INC.  
 LIVINGSTON/ROSENWINKEL, P.C. ARCHITECTS & PLANNERS  
 CONSULTING ARCHITECTS  
 PENNELL & WILTBERGER INC.  
 PHILADELPHIA DESIGN COLLABORATIVE  
 CONSULTING ENGINEERS  
 REVISIONS  
 ADDENDUM#2 10/24/90


PENNSYLVANIA CONVENTION CENTER PHILADELPHIA, PENNSYLVANIA

GENERAL NOTES  
 1. SEE HVAC-01 GENERAL NOTES TO UNIT HEATERS  
 2. CABINET UNIT HEATERS AND RADIANT COILS SHALL BE 3/4" PIPE SIZE, UNLESS OTHERWISE NOTED.

Sheets HHV-2.10, 14, 17, 21 & 27:  
 An exit enclosure shall not be used for any purpose other than a "fire escape". The HVAC piping shown going through exit stair enclosures and the HVAC risers shown going to the roof in exit stair enclosures shall be fire resistant construction or removed from the stair enclosure.

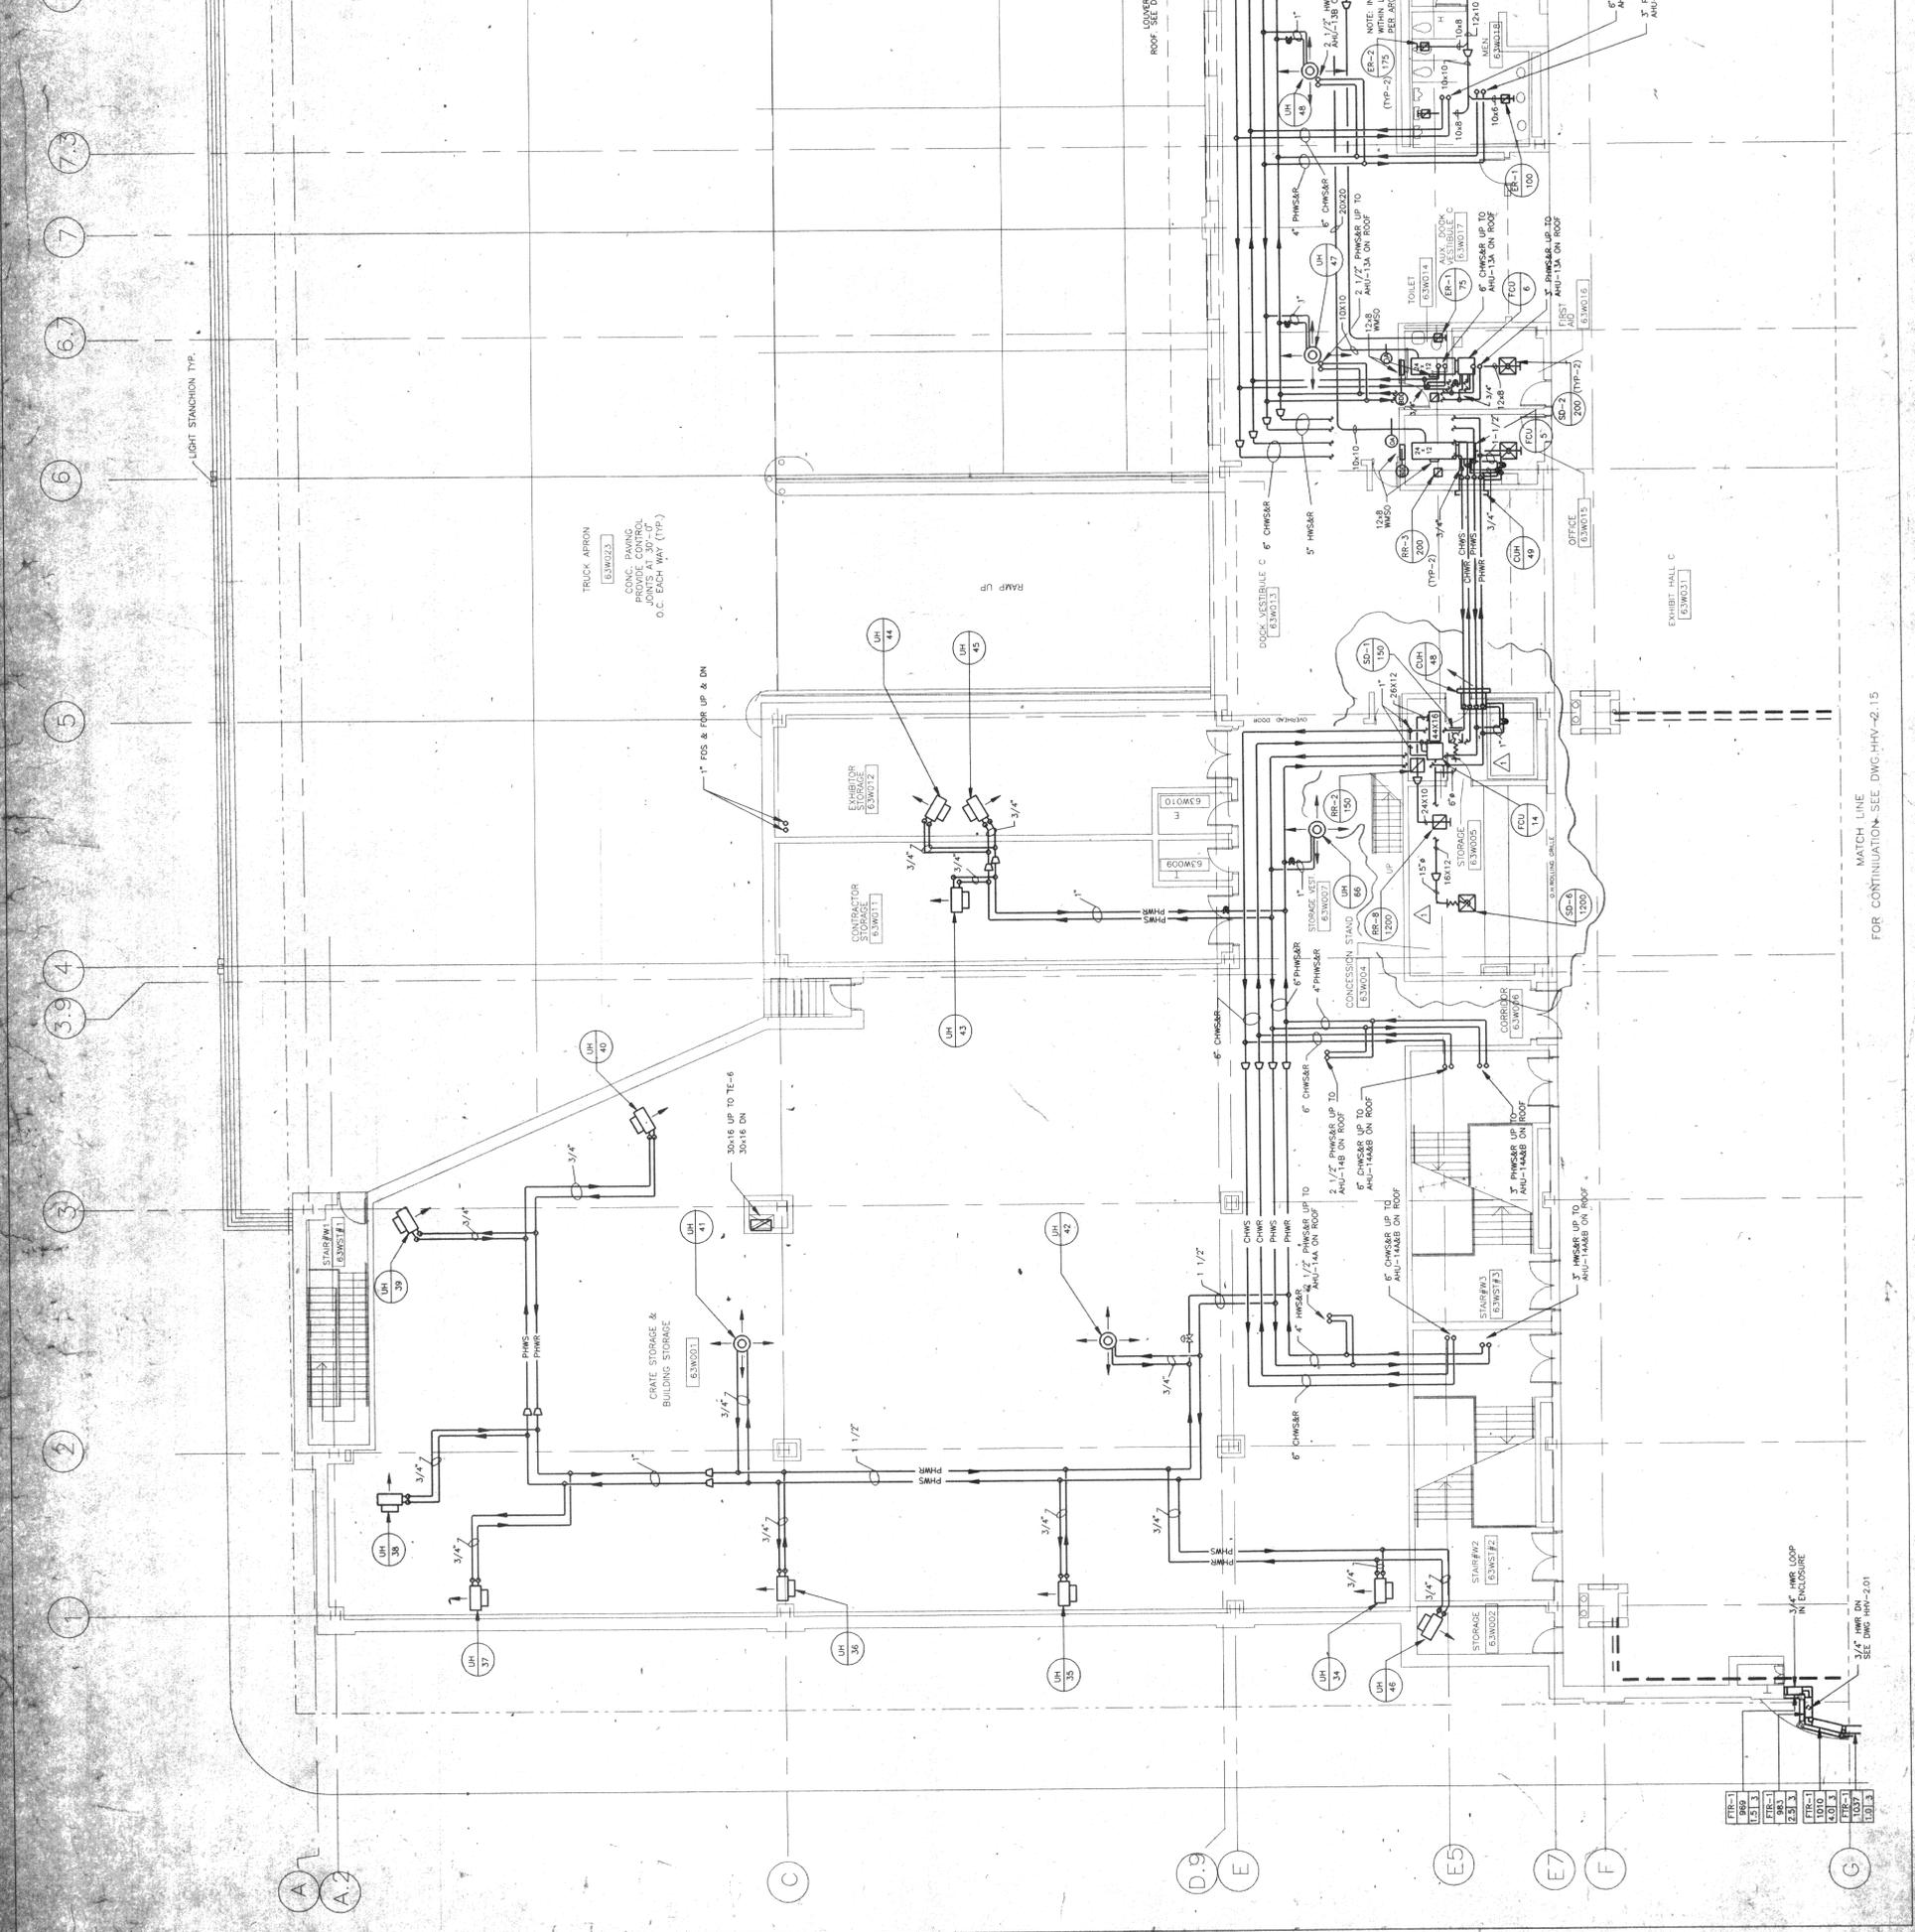

FOR CONTINUATION SEE DWG. HHV-2.17



GRAPHIC SCALE  
 0' 4' 8' 16'

PROJECT NO. 10/4/90  
 BLOCK "W" N.W.  
 DRAWING NO. HHV  
 ISSUE DATE 2.14  
 10/4/90

DRIVING TITLE  
 FLOOR PLAN  
 HALL LEVEL  
 63



ALL DIMENSIONS SHALL BE VERIFIED BY CONTRACTOR AND DISCREPANCIES SHALL BE CORRECTED BEFORE PROCEEDING WITH CONSTRUCTION.

TR-1	10/13
TR-2	10/13
TR-3	10/13
TR-4	10/13
TR-5	10/13
TR-6	10/13
TR-7	10/13
TR-8	10/13
TR-9	10/13
TR-10	10/13
TR-11	10/13
TR-12	10/13
TR-13	10/13
TR-14	10/13
TR-15	10/13
TR-16	10/13
TR-17	10/13
TR-18	10/13
TR-19	10/13
TR-20	10/13
TR-21	10/13
TR-22	10/13
TR-23	10/13
TR-24	10/13
TR-25	10/13
TR-26	10/13
TR-27	10/13
TR-28	10/13
TR-29	10/13
TR-30	10/13
TR-31	10/13
TR-32	10/13
TR-33	10/13
TR-34	10/13
TR-35	10/13
TR-36	10/13
TR-37	10/13
TR-38	10/13
TR-39	10/13
TR-40	10/13
TR-41	10/13
TR-42	10/13
TR-43	10/13
TR-44	10/13
TR-45	10/13
TR-46	10/13
TR-47	10/13
TR-48	10/13
TR-49	10/13
TR-50	10/13
TR-51	10/13
TR-52	10/13
TR-53	10/13
TR-54	10/13
TR-55	10/13
TR-56	10/13
TR-57	10/13
TR-58	10/13
TR-59	10/13
TR-60	10/13
TR-61	10/13
TR-62	10/13
TR-63	10/13
TR-64	10/13
TR-65	10/13
TR-66	10/13
TR-67	10/13
TR-68	10/13
TR-69	10/13
TR-70	10/13
TR-71	10/13
TR-72	10/13
TR-73	10/13
TR-74	10/13
TR-75	10/13
TR-76	10/13
TR-77	10/13
TR-78	10/13
TR-79	10/13
TR-80	10/13
TR-81	10/13
TR-82	10/13
TR-83	10/13
TR-84	10/13
TR-85	10/13
TR-86	10/13
TR-87	10/13
TR-88	10/13
TR-89	10/13
TR-90	10/13
TR-91	10/13
TR-92	10/13
TR-93	10/13
TR-94	10/13
TR-95	10/13
TR-96	10/13
TR-97	10/13
TR-98	10/13
TR-99	10/13
TR-100	10/13



PENNSYLVANIA CONVENTION CENTER PHILADELPHIA, PENNSYLVANIA

- GENERAL NOTES
- SEE HHV-1.01 GENERAL NOTES.
  - ALL BRANCH PIPING SHOWN TO UNIT CENTERLINE UNLESS OTHERWISE NOTED.
  - BE 3/4" PIPE SIZE UNLESS OTHERWISE NOTED.

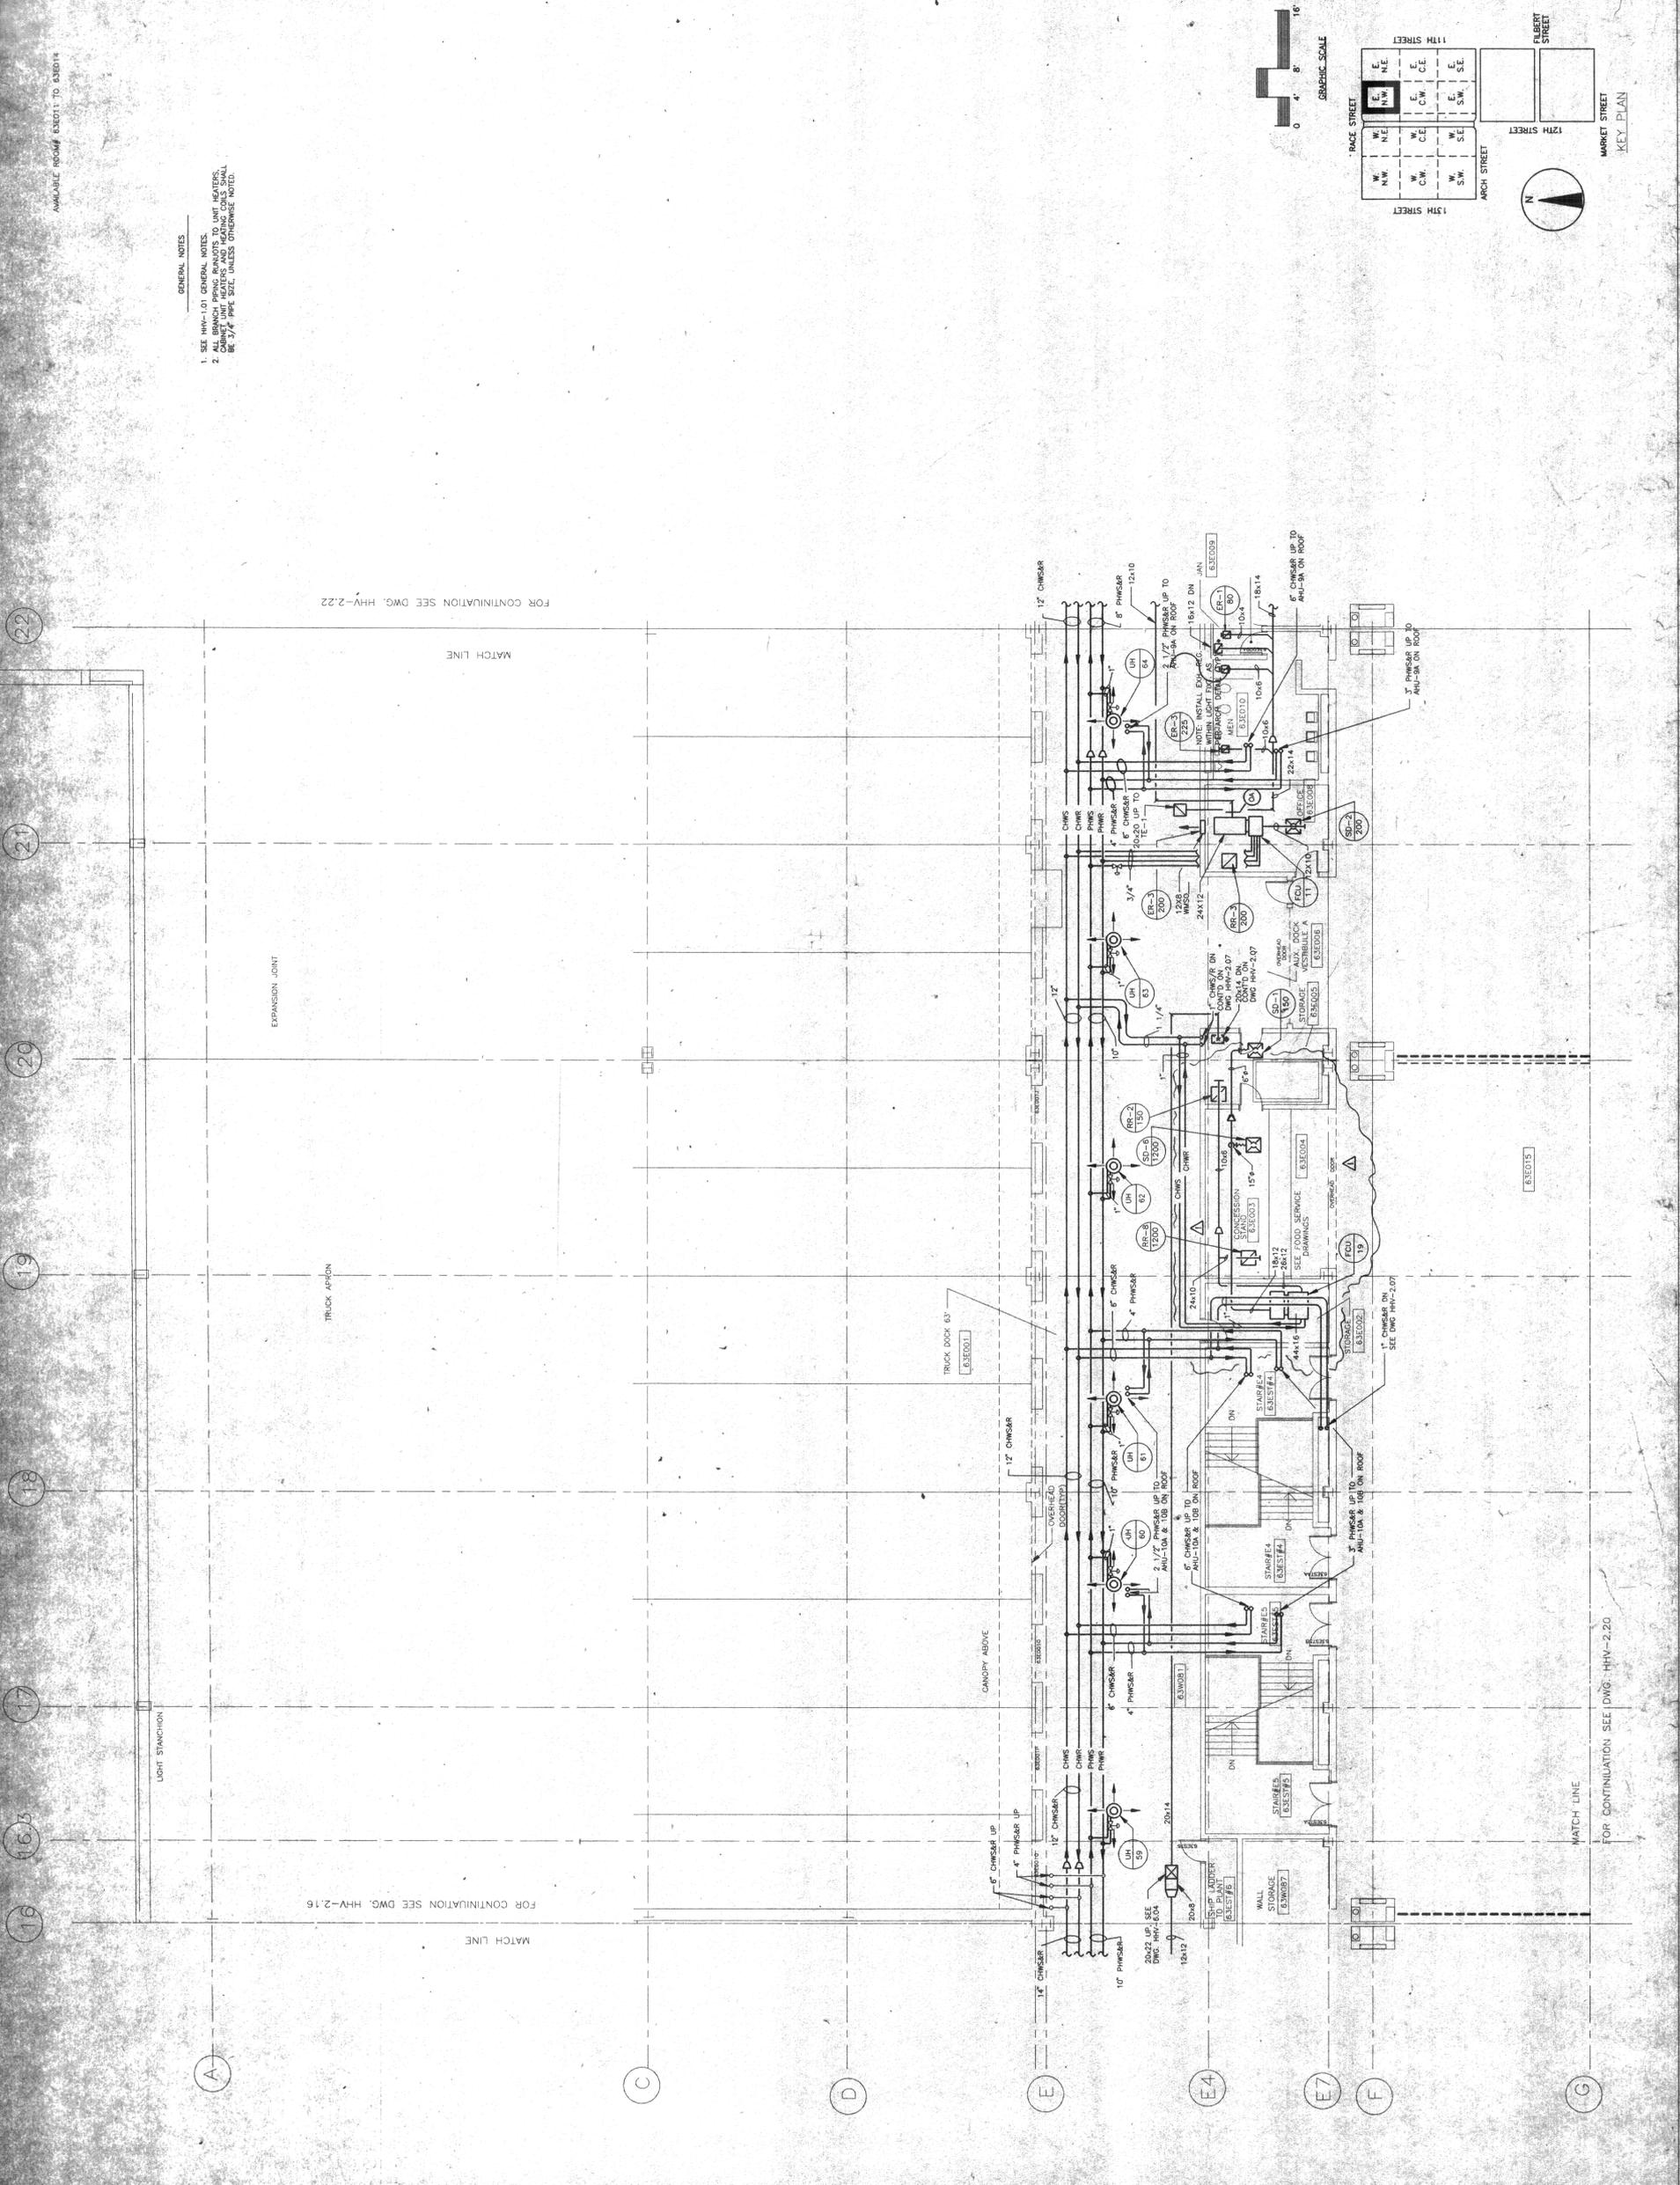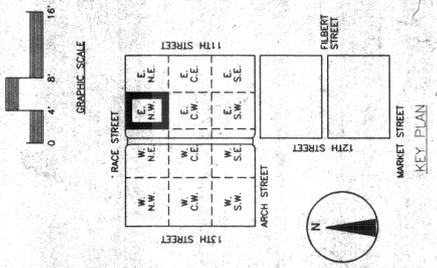

FOR CONTINUATION SEE DWG. HHV-2.16

FOR CONTINUATION SEE DWG. HHV-2.20

FOR CONTINUATION SEE DWG. HHV-2.22

THOMPSON VENTULETT STAINBACK & ASSOCIATES, INC. ARCHITECTS  
 VITETTA GROUP ASSOCIATED ARCHITECTS  
 KELLY/MAIELLO ARCHITECTS & PLANNERS, INC.  
 LIVINGSTON/ROSENWINKEL P.C. ARCHITECTS & PLANNERS  
 CONSULTING ARCHITECTS  
 PENNELL & WILTBERGER INC.  
 PHILADELPHIA DESIGN COLLABORATIVE

CONSULTING ENGINEERS  
 REVISIONS  
 ADDENDUM#2 10/24/90

PHILADELPHIA CONVENTION CENTER  
 PENNSYLVANIA

RELEASED FOR CONSTRUCTION  
 DATE: 10/4/90  
 1-15-11

PROJECT NO. 8803.00  
 TVCSA  
 BLOCK "E" N.E.  
 DRAWING NO. HHV  
 ISSUE DATE 10/7/90  
 2.21

DRAWING TITLE  
 FLOOR PLAN  
 HALL LEVEL  
 63

PHILADELPHIA CONVENTION CENTER  
 PENNSYLVANIA

PHILADELPHIA CONVENTION CENTER  
 PENNSYLVANIA

PHILADELPHIA CONVENTION CENTER  
 PENNSYLVANIA

PHILADELPHIA CONVENTION CENTER  
 PENNSYLVANIA

PHILADELPHIA CONVENTION CENTER  
 PENNSYLVANIA

PHILADELPHIA CONVENTION CENTER  
 PENNSYLVANIA


PHILADELPHIA CONVENTION CENTER  
 PENNSYLVANIA

PHILADELPHIA CONVENTION CENTER  
 PENNSYLVANIA

PHILADELPHIA CONVENTION CENTER  
 PENNSYLVANIA

PHILADELPHIA CONVENTION CENTER  
 PENNSYLVANIA

PHILADELPHIA CONVENTION CENTER  
 PENNSYLVANIA

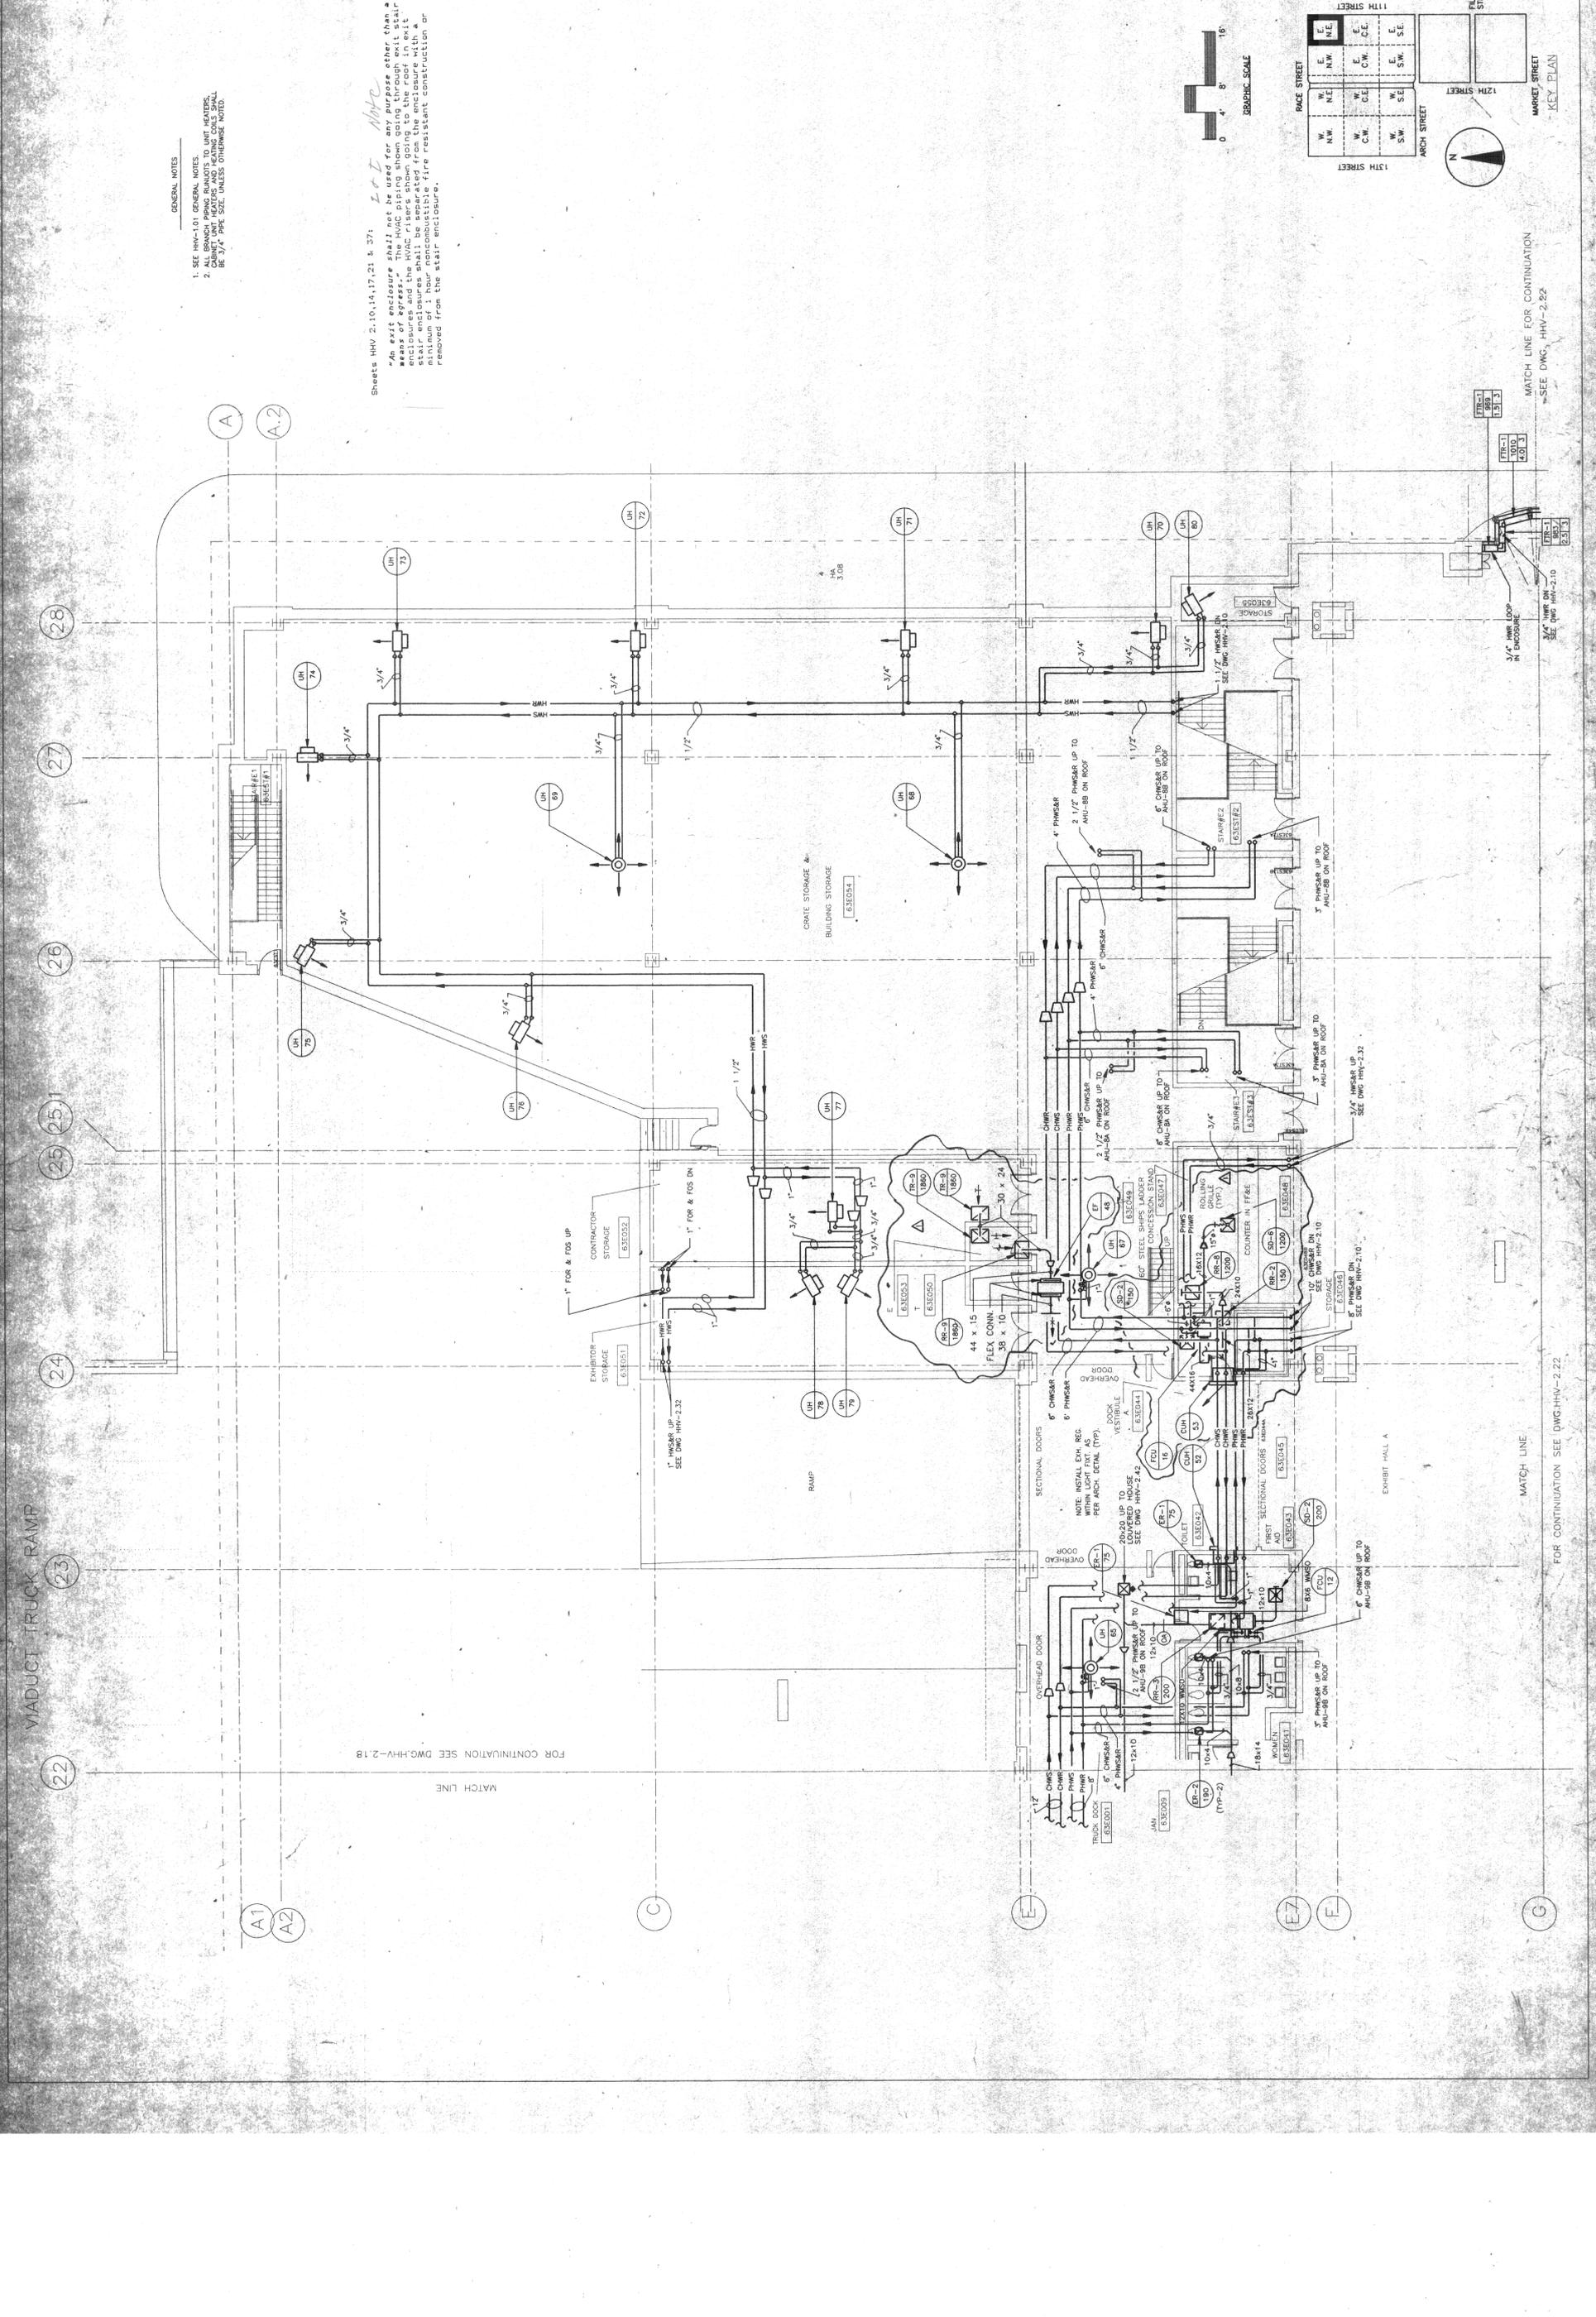

GENERAL NOTES  
 1. SEE HHV-1.01 GENERAL NOTES.  
 2. ALL BRANCH PIPING RUNNITS TO UNIT HEADERS SHALL BE 3/4" PIPE SIZE UNLESS OTHERWISE NOTED.

Notes:  
 "An exit enclosure shall not be used for any purpose other than a stair enclosure. The HVAC piping shown going through exit stair enclosures and the HVAC risers shown going to the roof in exit stair enclosures shall be separated from the enclosure by a minimum 1/2" fire resistant construction or removed from the stair enclosure."  
 Sheets HHV 2.10, 14, 17, 21 & 27:  
 I.T.T. MHC

FOR CONTINUATION SEE DWG. HHV-2.18  
 MATCH LINE

FOR CONTINUATION SEE DWG. HHV-2.22  
 MATCH LINE

FOR CONTINUATION SEE DWG. HHV-2.22  
 MATCH LINE

FOR CONTINUATION SEE DWG. HHV-2.22  
 MATCH LINE

FOR CONTINUATION SEE DWG. HHV-2.22  
 MATCH LINE

FOR CONTINUATION SEE DWG. HHV-2.22  
 MATCH LINE

FOR CONTINUATION SEE DWG. HHV-2.22  
 MATCH LINE

FOR CONTINUATION SEE DWG. HHV-2.22  
 MATCH LINE

FOR CONTINUATION SEE DWG. HHV-2.22  
 MATCH LINE

FOR CONTINUATION SEE DWG. HHV-2.22  
 MATCH LINE


FOR CONTINUATION SEE DWG. HHV-2.22  
 MATCH LINE

FOR CONTINUATION SEE DWG. HHV-2.22  
 MATCH LINE

FOR CONTINUATION SEE DWG. HHV-2.22  
 MATCH LINE

FOR CONTINUATION SEE DWG. HHV-2.22  
 MATCH LINE


FOR CONTINUATION SEE DWG. HHV-2.22  
 MATCH LINE

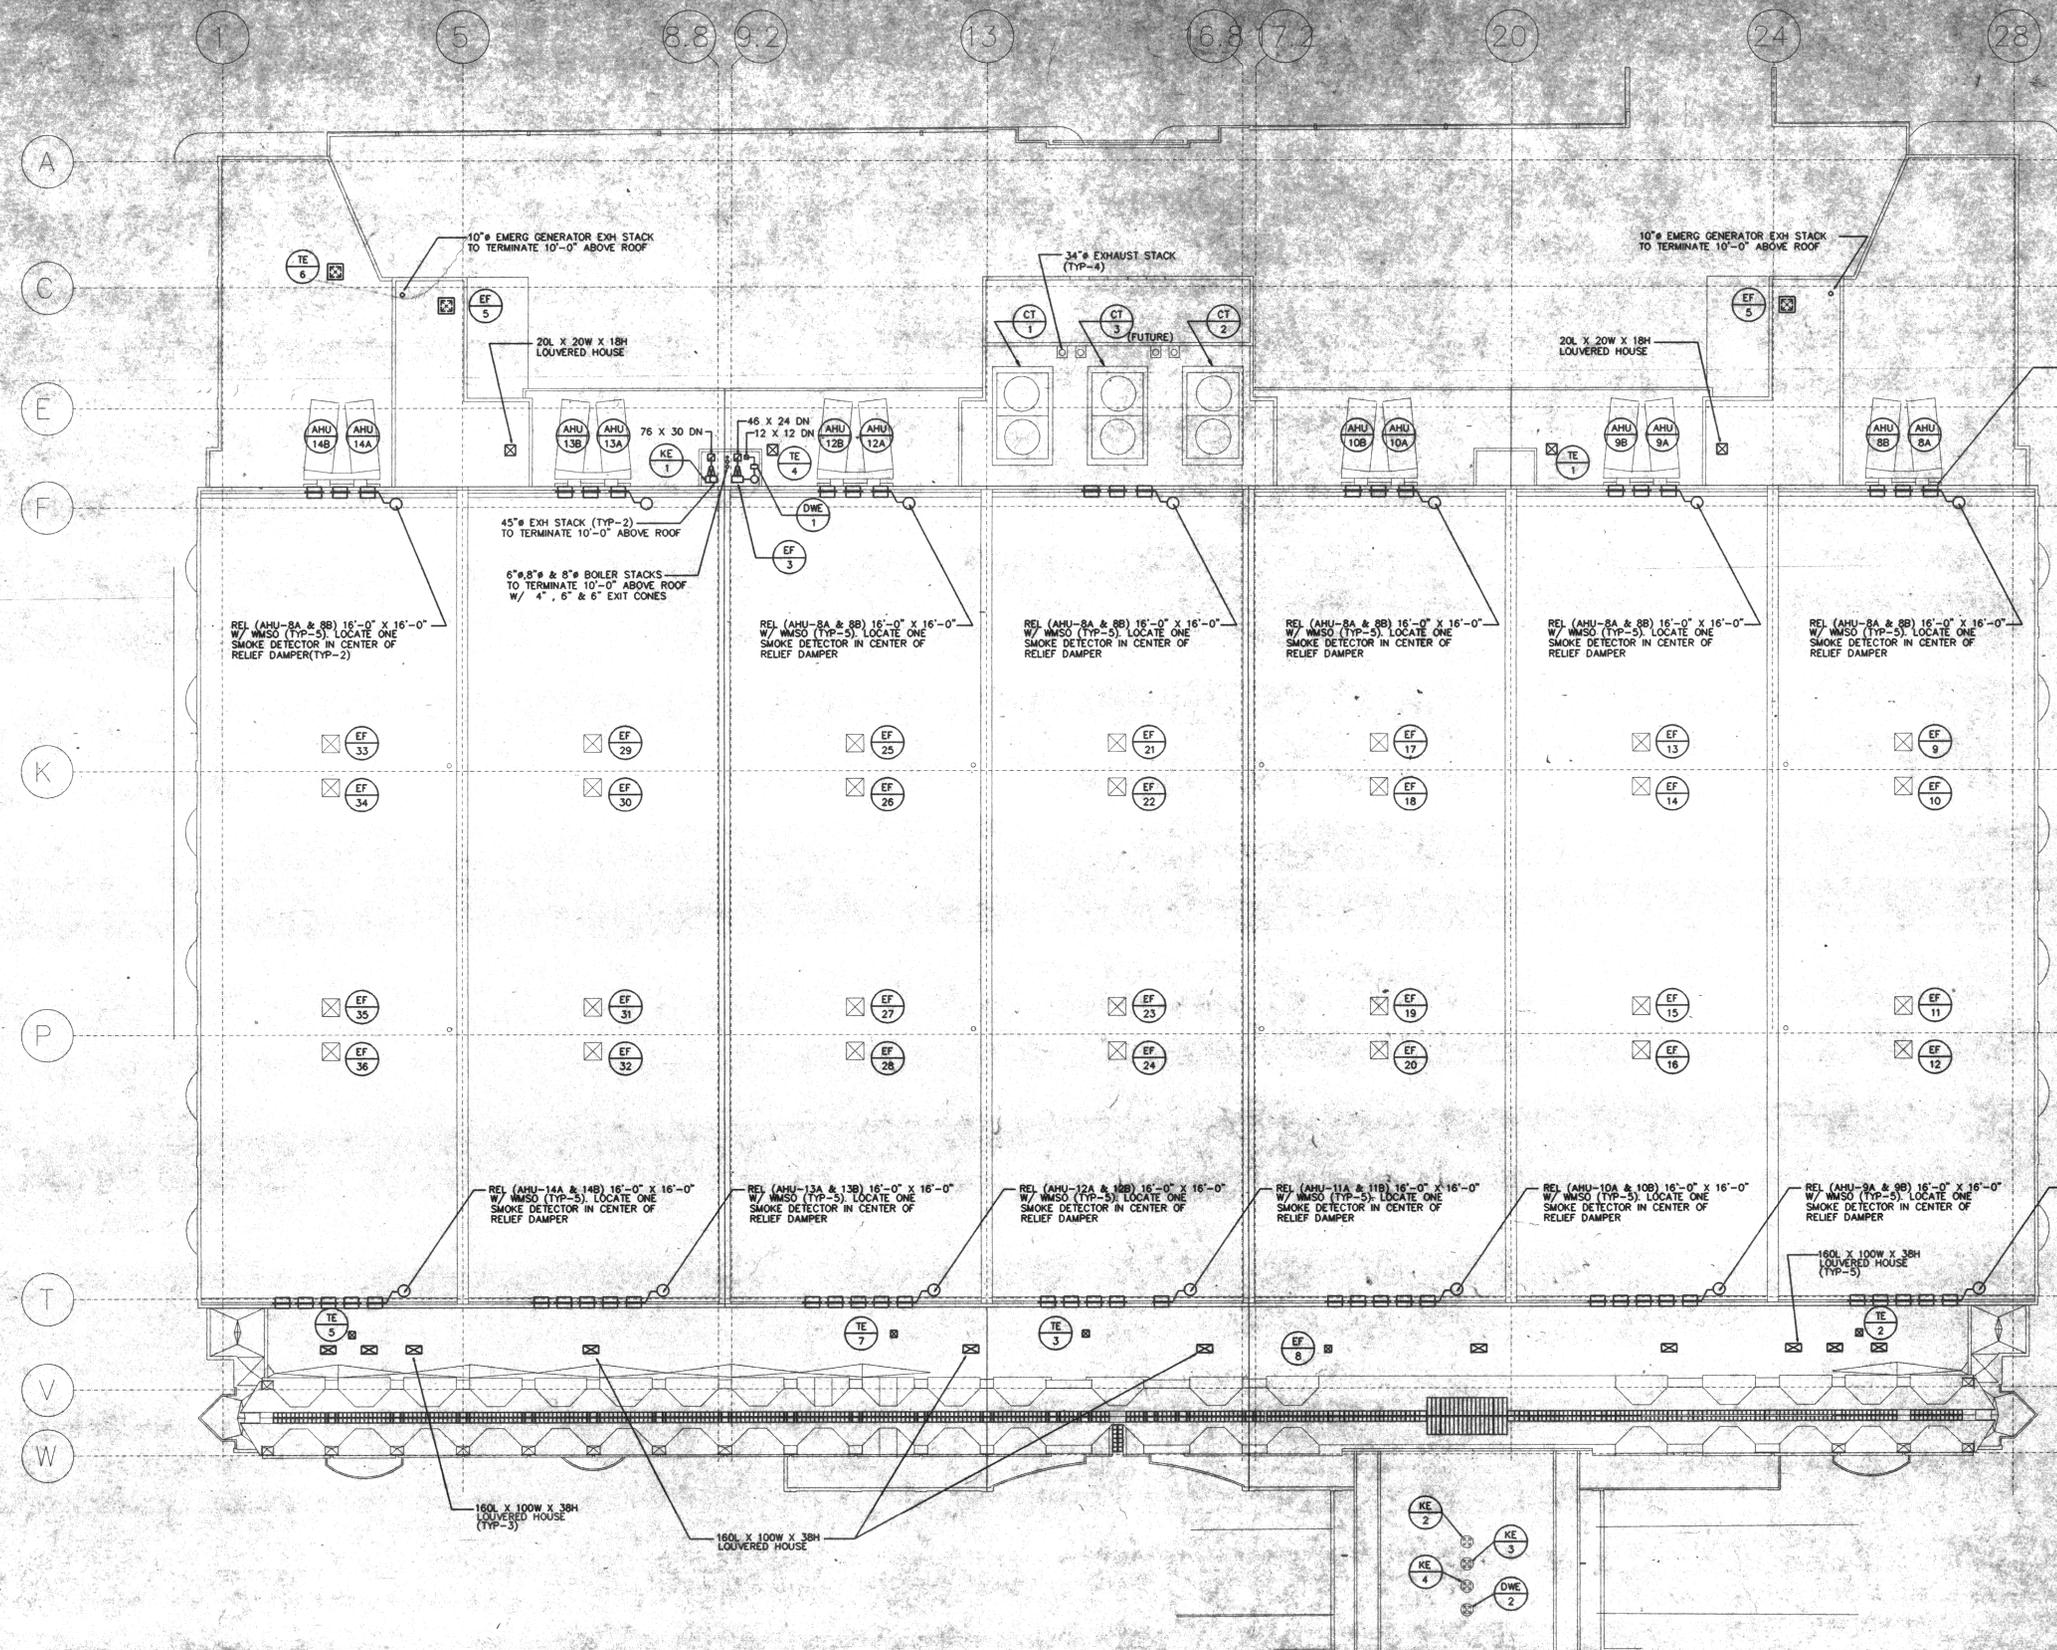

**GENERAL NOTES**

- SEE HHV-1.01 GENERAL NOTES.
- ALL BRANCH PIPING RUNOUTS TO UNIT HEATERS, CABINET UNIT HEATERS AND HEATING COILS SHALL BE 3/4" PIPE SIZE, UNLESS OTHERWISE NOTED.

REFER TO HA SERIES DRAWINGS FOR EXACT LOCATION AND SIZE OF ASSOCIATED RELIEF AIR LOUVERS(TYP)



THOMPSON  
VENTURE  
STAINBACK  
&  
ASSOCIATES, INC.  
ARCHITECTS

VITETTA  
GROUP  
ASSOCIATED ARCHITECTS

KELLY/  
MAIELLO  
ARCHITECTS &  
PLANNERS, INC.

LIVINGSTON/  
ROSENWINKEL,  
P.C.  
ARCHITECTS &  
PLANNERS

CONSULTING ARCHITECTS

PENNELL &  
WILBERGER  
INC.

PHILADELPHIA  
DESIGN  
COLLABORATIVE

CONSULTING ENGINEERS

REVISIONS

All dimensions shall be verified by contractor and architect notified of any discrepancies before proceeding with construction.



DRAWING TITLE

ROOF PLAN

PROJECT NO. DRAWING NO.  
TVSRA 8803.00 HHV  
VC 2.42  
ISSUE DATE  
10/4/90